


LIGHTING PLAN LEGEND

(APPLIES TO SHEETS 10-12)

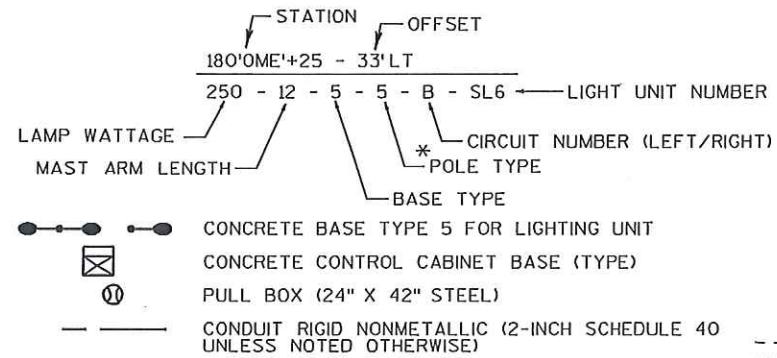

CIRCUIT "A"

"B"

"C"

"D"

NOTES: (APPLIES TO SHEETS 10-12)

1) WISCONSIN DOT NORTHEAST REGION ELECTRICAL UNIT SHALL APPROVE THE FINAL LOCATION FOR ALL CONCRETE BASES IN THE FIELD PRIOR TO INSTALLATION. CONTACT THEM 3 DAYS IN ADVANCE AT (920) 492-5654 OR (920) 492-5628. FOR CITY OF OSHKOSH CIRCUITS CALL WITH 3 DAYS ADVANCED NOTICE @ (920) 232-5350.

2) PITCH ALL CONDUIT TOWARD PULLBOXES. A 2" DRAIN DUCT TO DITCH OR STORM SEWER REQUIRED FOR ALL PULL BOXES IN LOW POINTS. THIS 2" DRAIN DUCT IS INCIDENTAL TO THE PULL BOX BID ITEM AND IS NOT SHOWN.

3) THE LOCATION OF EXISTING AND PROPOSED UTILITIES AS SHOWN ON THE PLANS ARE APPROXIMATE. IN ADDITION, THERE MAY BE OTHER UTILITIES WITHIN THE PROJECT AREA WHICH ARE NOT SHOWN. THE CONTRACTOR SHALL VERIFY THE LOCATIONS OF ALL UTILITIES PRIOR TO CONSTRUCTION.

4) THE WISCONSIN DOT NORTHEAST REGION WILL FURNISH AND INSTALL A LIGHTING CONTROL CABINET AND TERMINATE ALL CABINET WIRING FOR CONCRETE BASE CB200 & CB300.

5) REFER TO ITS PLANS FOR LOCATIONS OF SHARED INFRASTRUCTURE.

6) REFER TO SPECIAL PROVISIONS FOR STAGED LIGHTING CONSTRUCTION REQUIREMENTS.

7) CONDUIT RIGID METALLIC IS REQUIRED ACROSS ALL STRUCTURE EXPANSION/DEFLECTION JOINTS. FIVE FEET (MINIMUM) ON EITHER SIDE OF THE EXPANSION/DEFLECTION JOINT REQ'D. APPLY ASPHALTIC SEALANT TO ANY EXPOSED METALLIC CONDUIT. EXPANSION/DEFLECTION FITTING BONDING JUMPER & ASPHALTIC SEALANT TO BE CONSIDERED INCIDENTAL TO THE CONDUIT.

PROJECT NO: 1120-11-75

HWY: USH 41

COUNTY: WINNEBAGO

LIGHTING - STH 21

SHEET

275

E

FILE NAME : G:\WDOT\NE\WNE30-0739\WINNEBAGO COUNTY - 01\1120-11-75 (USH 41 CENTRAL)\DGN\PLAN SHEETS\023510_LP.dgn


PLOT DATE : 4/4/2011

PLOT BY : KL Engineering

PLOT NAME :

PLOT SCALE :

WISDOT/CADD SHEET 42

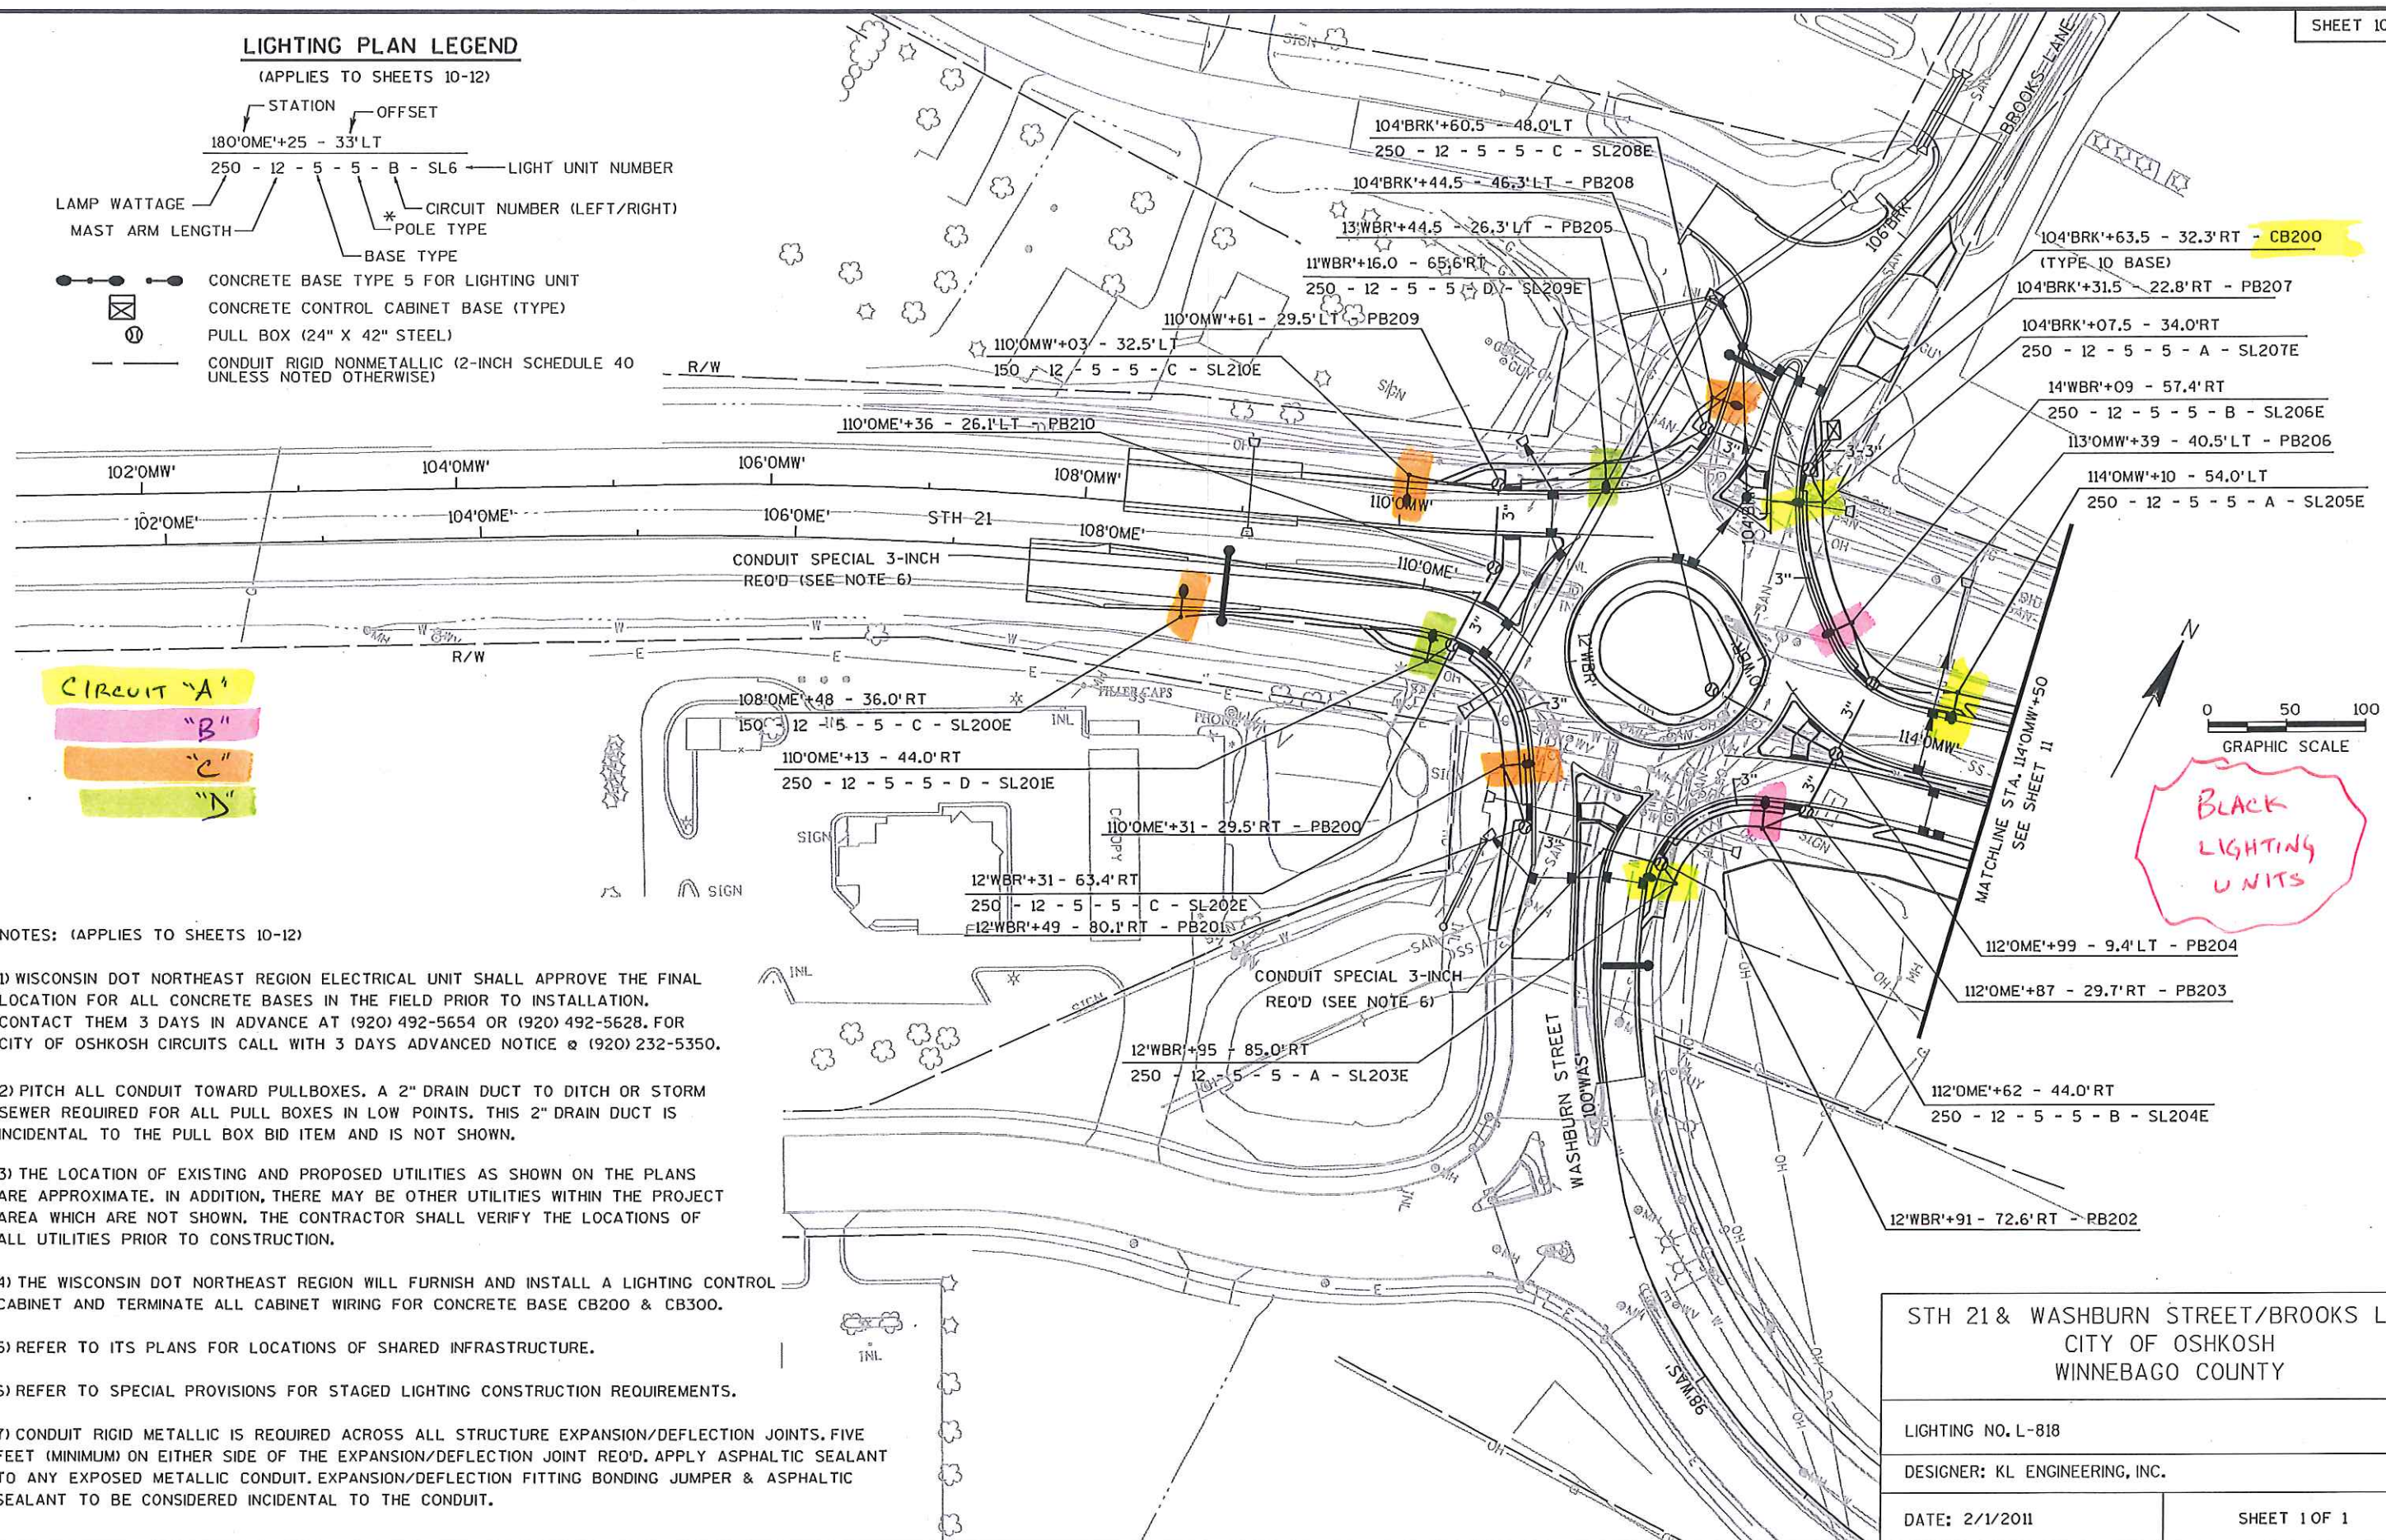

STH 21 & WASHBURN STREET/BROOKS LANE
CITY OF OSHKOSH
WINNEBAGO COUNTY

LIGHTING NO. L-818

DESIGNER: KL ENGINEERING, INC.

DATE: 2/1/2011

SHEET 1 OF 1

