



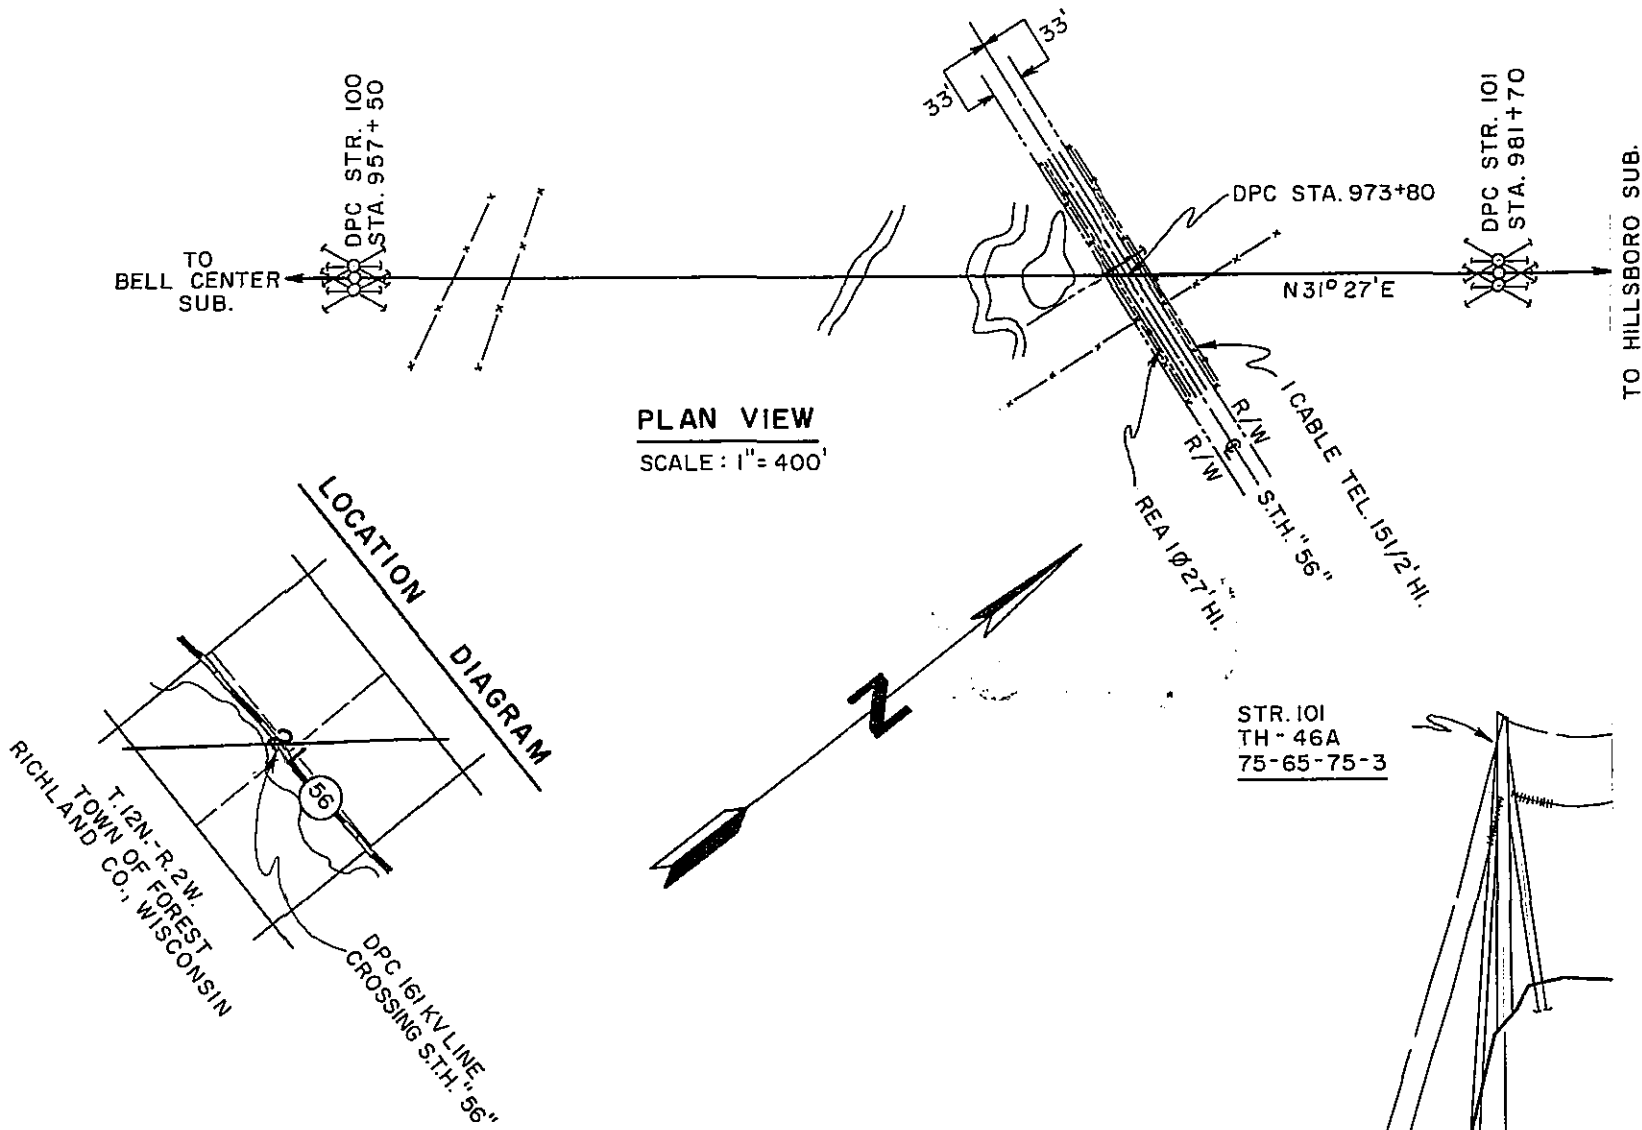

DESIGN DATA

3 CONDUCTORS 636 MCM 26/7 ACSR
10,000 LBS. (40% ULT.) DESIGN TENSION
WITH 4 LBS. WIND ON 1/2" ICE AT 0° F + K

2 OVERHEAD GROUND WIRES 7 STRAND EHS STEEL
5240 LBS. (34% ULT.) DESIGN TENSION
1200' RULING SPAN 161KV LINE 120° FINAL SHOWN

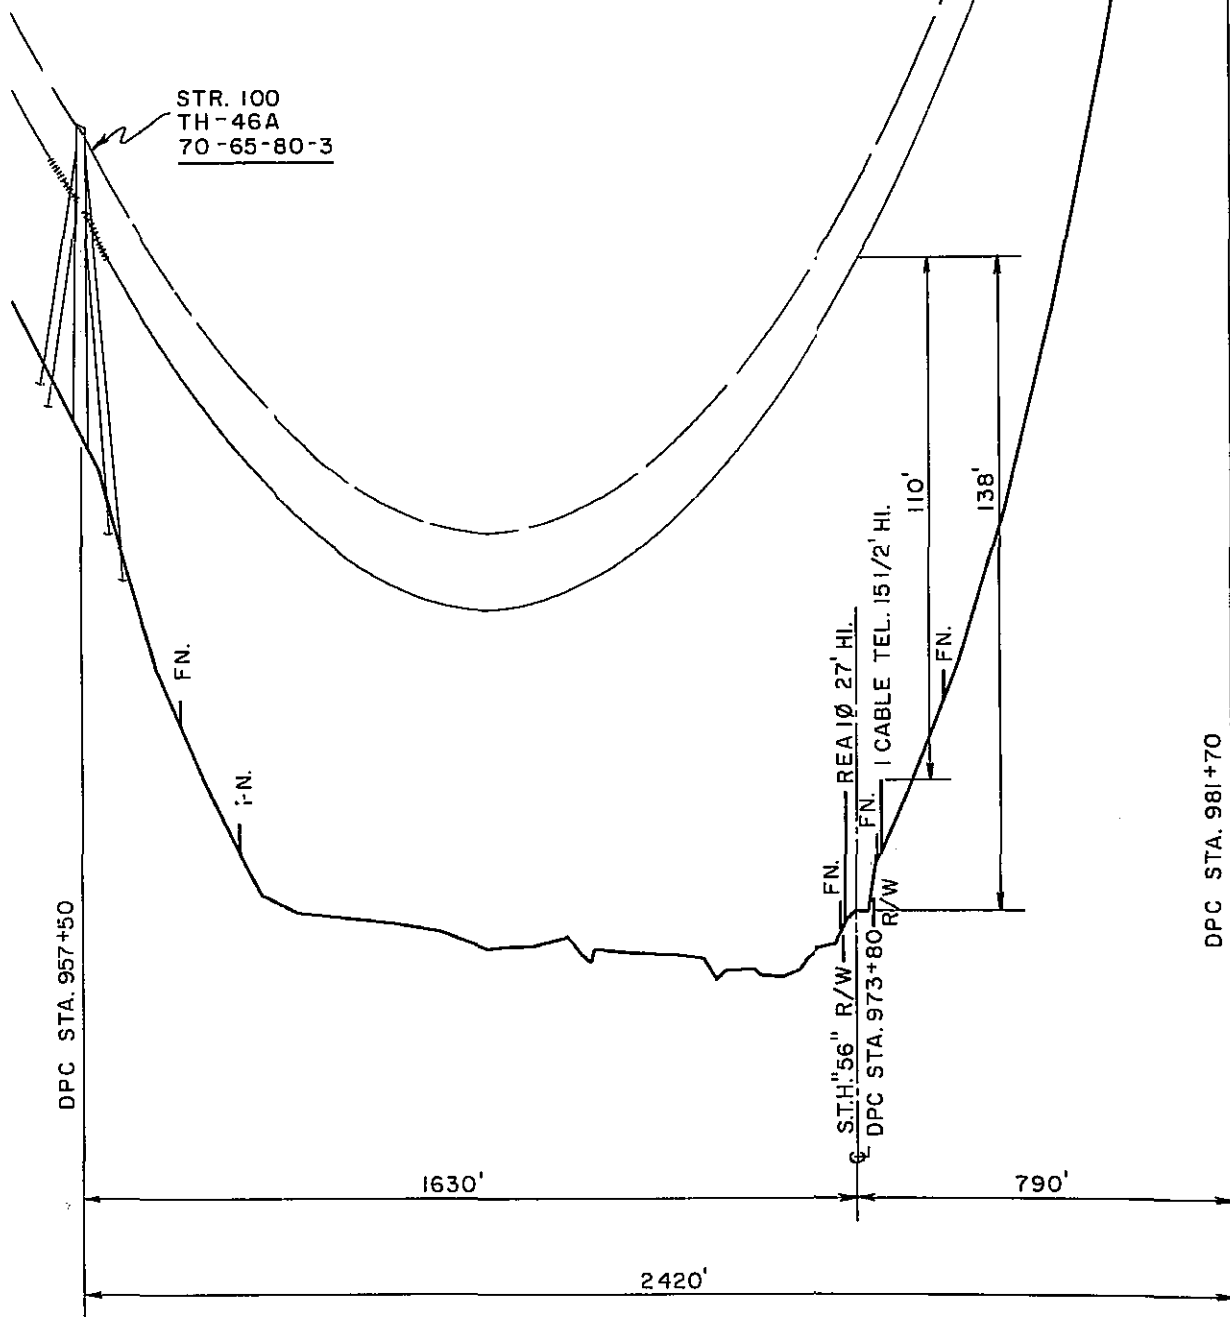

NO.	DATE	REVISION	MADE BY	APPR'D BY

DAIRYLAND POWER COOPERATIVE		BELL CENTER-HILLSBORO	
LA CROSSE, WISCONSIN		161KV Q-13 LINE	
CROSSING S.T.H. "56"		DRAWING NO.	
WORK ORDER NO. 71-235		SHEET OF	
ISSUED		DATE 10-31-74	
DRAWN DES		TRACED	
SUPERSEDES		CHECKED	
APPROVED		R-240-22	